

GATE

2018



27
YEARS
SOLUTION

GATE SOLUTIONS

ELECTRICAL ENGINEERING

From (1991 - 2017)



Office : F-126, (Lower Basement), Katwaria Sarai, New Delhi-110016 • **Phone :** 011-26522064
Mobile : 8130909220, 9711853908 • **E-mail:** info@iesmasterpublications.com, info@iesmaster.org
Web : iesmasterpublications.com, iesmaster.org



IES MASTER PUBLICATION

F-126, (Lower Basement), Katwaria Sarai, New Delhi-110016

Phone : 011-26522064, **Mobile** : 8130909220, 9711853908

E-mail : info@iesmasterpublications.com, info@iesmaster.org

Web : iesmasterpublications.com, iesmaster.org

All rights reserved.

Copyright © 2017, by IES MASTER Publications. No part of this booklet may be reproduced, or distributed in any form or by any means, electronic, mechanical, photocopying, recording, or otherwise or stored in a database or retrieval system without the prior permission of IES MASTER, New Delhi. Violates are liable to be legally prosecuted.

Second Edition : 2017

PREFACE

It is an immense pleasure to present topic wise previous years solved paper of GATE Exam. This booklet has come out after long observation and detailed interaction with the students preparing for GATE exam and includes detailed explanation to all questions. The approach has been to provide explanation in such a way that just by going through the solutions, students will be able to understand the basic concepts and will apply these concepts in solving other questions that might be asked in future exams.

GATE exam now a days has become more important because it not only opens the door for higher education in institutes like IIT, IISc, NIT's but also many of the PSUs have started inducting students on the basis of GATE score. In PSU's, which are not inducting through GATE route, the questions in their exams are asked from GATE previous year papers. Thus, availability of authentic solutions to the students is the need of the day. Towards this end this booklet becomes indispensable.

I am thankful to IES master team without whose support, I don't think, this book could have been flawlessly produced.

Every care has been taken to bring an error free book. However comments for future improvement are most welcome.

Mr. Kanchan Kumar Thakur
Director Ex-IES

GATE 2018

Online Test Series

GOTS Starts from

15th
July 2017

Registration Open Now

BRANCHES



42 Topic-wise Tests

12 Subject-wise Tests

10 Tests on Mixed Subjects

6 Full Length Tests

Total

70 Tests

Also Available COMBO PACK: **70 Tests + GATE 2018 Book**



CONTENTS

1. Power Systems	01 – 120
2. Electrical Machines	121– 240
3. Power Electronics	241 – 312
4. Electrical and Electronic Measurements	313 – 370
5. Control System	371 – 472
6. Electromagnetic Field Theory	473 – 506
7. Digital Electronics & Microprocessors	507 – 552
8. Analog Electronics	553 – 636
9. Circuit Theory	637 – 738
10. Signals and Systems	739 – 798
11. Engineering Mathematics	799 – 852
12. General Ability	853 – 885

Power Systems

Unit

1

Syllabus

Power generation concepts, ac and dc transmission concepts, Models and performance of transmission lines and cables, Series and shunt compensation, Electric field distribution and insulators, Distribution systems, Per-unit quantities, Bus admittance matrix, Gauss Seidel and Newton-Raphson load flow methods, Voltage and frequency control, Power factor correction, Symmetrical components, Symmetrical and unsymmetrical fault analysis, Principles of over-current, differential and distance protection; Circuit breakers, System stability concepts, Equal area criterion.

Contents

<i>Chapter No.</i>	<i>Topic</i>	<i>Page No.</i>
1.	Generating Power Stations and Per Unit System -----	01–06
2.	Overhead Transmission Lines (Line parameters, Performance of lines, HVDC, Corona, Cables, Insulators & Distribution Systems) -----	07–38
3.	Symmetrical Components and Fault Calculations -----	39–62
4.	Power System Stability -----	63–78
5.	Load Flow -----	79–93
6.	Economic Load Dispatch and Load Frequency Control -----	94–102
7.	Voltage Control and Compensation in Power System -----	103–110
8.	Power System Protection -----	111–120

Generating Power Stations and Per Unit System

1 – Mark

1. A 500 MVA, 11 KV synchronous generator has 0.2 p.u. synchronous reactance. The p.u. synchronous reactance on the base values of 100 MVA and 22 KV is
 (a) 0.16 (b) 0.01
 (c) 4.0 (d) 0.25 **[GATE-1991]**
2. In order to have a lower cost of electrical energy generation
 (a) The load factor and diversity factor should be low
 (b) The load factor should be low but diversity factor should be high
 (c) The load factor should be high but diversity factor should be low
 (d) The load factor and diversity factor should be high. **[GATE-1995]**
3. Which material is used in controlling chain reaction in a nuclear reactor?
 (a) Thorium (b) Heavy water
 (c) Boron (d) Beryllium **[GATE-1996]**
4. In a thermal power plant, the feed water coming to the economiser is heated using
 (a) H.P. Steam
 (b) L.P. Steam
 (c) Direct heat in the furnace
 (d) Flue gases **[GATE-2000]**
5. The rated voltage of a 3-phase power system is given as
 (a) rms phase voltage
 (b) peak phase voltage
 (c) rms line to line voltage
 (d) peak line to line voltage. **[GATE-2004]**
6. In thermal power plants, the pressure in the working fluid cycle is developed by
 (a) condenser (b) super heater
 (c) feed water pump (d) turbine **[GATE-2004]**
7. For harnessing low variable waterheads, the suitable hydraulic turbine with high percentage of reaction and runner adjustable vanes is
 (a) Kaplan (b) Francis
 (c) Pelton (d) Impeller **[GATE-2004]**
8. Out of the following plant categories :
 (i) Nuclear (ii) Run-off-river
 (iii) Pump Storage (iv) Diesel
 The base load power plants are
 (a) (i) and (ii) (b) (ii) and (iii)
 (c) (i), (ii) and (iv) (d) (i), (iii) and (iv) **[GATE-2009]**
9. A three phase star-connected load is drawing power at a voltage of 0.9 pu and 0.8 power factor lagging. The three phase base power and base current are 100 MVA and 437.38.A respectively. The line-to-line load voltage in kV is _____. **[GATE-2014]**
10. Base load power plants are
 P: wind farms
 Q: run-off-river plants
 R: nuclear power plants
 S: diesel power plants
 Choose the correct answer :
 (a) P, Q and S only (b) P, R and S only
 (c) P, Q and R only (d) Q and R only **[GATE-2015]**



IES MASTER

Institute for Engineers (IES/GATE/PSUs)

CE
ME
EE
ECE

Computer Based Test
at **35** Centres

MTRE
Scholarship
For **ESE & GATE** Aspirants
Session 2018-19

Get up to
100% Scholarship

in each branch

Master Talent
Reward Exam

Registration
Open

Last Date
of Registration

18th Dec

Exam Date

24th Dec

Visit iesmaster.org/master-talent-reward-exam or Call on +91 8010009955 | +91 9711853908

2 – Marks

- The synchronous reactance of a 200 MVA, 10kV, 3-phase, 50 Hz generator is 1.0 p.u. at its own base. Its p.u. reactance at 100 MVA, 20 kV base will be _____.
[GATE-1997]
- An industrial consumer has a daily load pattern of 2000 kW, 0.8 lag for 12 hrs and 1000 kW UPF for 12 hrs. The load factor is
(a) 0.5 (b) 0.6
(c) 0.75 (d) 2.0 [GATE-1999]
- The plug setting of a negative sequence relay is 0.2A. The current transformer ratio is 5 : 1. The minimum value of line to line fault current for the operation of the relay is
(a) 1 A (b) $\frac{1}{1.732}$ A
(c) 1.732 A (d) $\frac{0.2}{1.732}$ A
[GATE-2000]
- A 3-phase transformer has rating of 20 MVA, 220 kV (star)-33 kV (delta) with leakage reactance of 12%. The transformer reactance (in ohms) referred to each phase of the L.V. delta-connected side is
(a) 23.5 (b) 19.6
(c) 18.5 (d) 8.7 [GATE-2001]
- A 75 MVA, 10 kV synchronous generator has $X_d = 0.4$ pu. The X_d value (in pu) to a base of 100 MVA, 11 kV is
(a) 0.578 (b) 0.279
(c) 0.412 (d) 0.44 [GATE-2001]
- A hydraulic turbine having rated speed of 250 rpm is connected to a synchronous generator. In order to produce power at 50 Hz, the number of poles required in the generator are
(a) 6 (b) 12
(c) 16 (d) 24 [GATE-2004]
- A generator is connected through a 20 MVA, 13.8/138 kV step down transformer, to a transmission line. At the receiving end of the line a load is supplied through a step down transformer of 10 MVA, 138/69 kV rating. A 0.72 p.u. load, evaluated on load side transformer ratings as base values, is

supplied from the above system. For system base value of 10 MVA and 69 kV in load circuit, the value of the load (in per unit) in generator circuit will be -

- (a) 36 (b) 0.144
(c) 0.72 (d) 0.18 [GATE-2006]

- For the power system shown in the figure below, the specifications of the components are the following :


$G_1 = 25$ kV, 100 MVA, $X = 9\%$

$G_2 = 25$ kV, 100 MVA, $X = 9\%$


$T_1 = 25$ kV/220 kV, 90 MVA, $X = 12\%$

$T_2 = 220$ kV/25kV, 90 MVA, $X = 12\%$

Line 1 : 220 kV, $X = 150$ ohms.

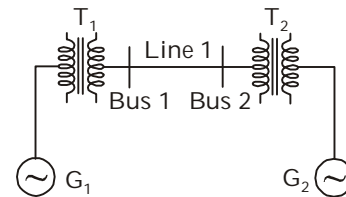

Choose 25 kV as the base voltage at the generator G_1 and 200 MVA as the MVA base. The impedance diagram is

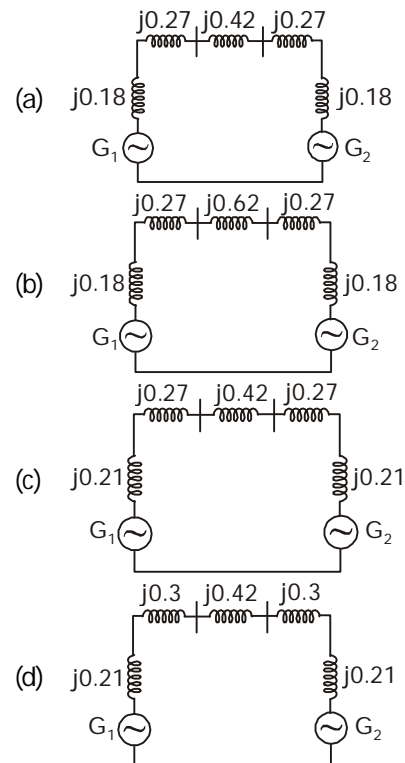

[GATE-2010]

ANSWER KEY

:: 1 MARK ::

1. (b)
2. (d)
3. (c)
4. (d)
5. (c)
6. (c)

7. (a)

8. (a)

9. (118.8kV)

10. (d)

:: 2 MARKS ::

1. (0.125 p.u.)

2. (c)

3. (c)

4. (b)

5. (d)

6. (d)

7. (b)

8. (b)


SOLUTION... **1 – Mark****Sol-1: (b)**

$$\begin{aligned} Z(\text{p.u.})_{\text{new}} &= Z(\text{p.u.})_{\text{old}} \times \left(\frac{KV_{\text{old}}}{KV_{\text{new}}} \right)^2 \times \left(\frac{MVA_{\text{new}}}{MVA_{\text{old}}} \right) \\ &= 0.2 \times \left(\frac{11}{22} \right)^2 \times \frac{100}{500} \\ &= \frac{0.2}{20} = 0.01 \end{aligned}$$

Sol-2: (d)

In order to have a lower cost of electric energy generation the Load factor should be high.

$$\text{Load factor} = \frac{\text{Average load}}{\text{Peak load}}$$

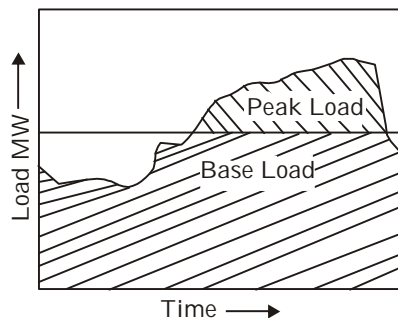

To economize generation, the load is divided into the two parts, base load and peak load. These two loads are supplied from separate plants called the base load plant and the peak load plant.

A base load plant operates at a high load factor.

$$\text{Group diversity factor} = \frac{\text{Sum of individual maximum demand}}{\text{Maximum demand of the group}}$$

Daily load diversity results in reduced operating expenses.

Sol-3: (c)

Control rods are used to control the chain reaction in a nuclear reactor. Control rods are made up of materials having high absorption cross section. Such materials are Boron, Hafnium and Cadmium.

Sol-4: (d)

Flue gases coming out of the boilers carry lot of heat. An economiser extracts a part of this heat from the flue gases and uses it for heating feed water.

Sol-5: (c)

The rated voltage of a 3-phase power system is always rms line to line voltage.

Sol-6: (c)

In thermal power plants, heaters bleed steam from the main turbine and use it for feed water heating. The feed water is heated, put under pressure by feed water pump and then further heated so that its temperature approaches and pressure exceeds that of water in the boiler.

Sol-7: (a)

- Propeller turbine is a reaction turbine suitable for low head and large quantity of water. It is suitable for heads below 30m.
- A Kaplan turbine is a propeller turbine with adjustable blades, the advantage of adjustable blades being that a Kaplan turbine operates at high efficiency even under part load conditions.

Sol-8: (a)

Nuclear and Run-off-river plants are the base load plant and Pumped Storage and Diesel plants are peak load plants.

Note : A base load plant operates at a high load factor and should be one which has low operating costs.

The peak load plant operates at a low load factor.

Sol-9: (118.8kV)

$$\text{Base kV} = \frac{\text{Base kVA}}{\sqrt{3} \times \text{Base current, A}}$$

$$= \frac{100 \times 10^3}{\sqrt{3} \times 437.38} = 132 \text{ kV}$$

$$\begin{aligned} \therefore \text{Actual line to line voltage} \\ &= (\text{p.u. value}) \times \text{Base voltage} \\ &= 0.9 \times \text{Base voltage} \\ &= 0.9 \times 132 = 118.8 \text{ kV} \end{aligned}$$

Sol-10: (d)

Diesel plants are very costly and thus not used as base load plants.

Wind plants are intermittent and hence they can't serve as base load plants.

Run off river plants are base load plants.

Nuclear plants aren't turned on/off frequently due to safety and economic reasons hence used as base load plants.

2 – Marks**Sol-1: (0.125 p.u.)**

$$Z_{\text{p.u.,new}} = Z_{\text{p.u.,old}} \cdot \left(\frac{\text{kV}_{\text{old}}}{\text{kV}_{\text{new}}} \right)^2 \cdot \left(\frac{\text{MVA}_{\text{new}}}{\text{MVA}_{\text{old}}} \right)$$

$$\begin{aligned} &= 1 \cdot \left(\frac{10}{20} \right)^2 \cdot \left(\frac{100}{200} \right) \\ &= \frac{1}{8} \text{ p.u.} = 0.125 \text{ p.u.} \end{aligned}$$

Sol-2: (c)

$$\text{Load factor} = \frac{\text{Average Demand}}{\text{Maximum Demand}}$$

Average demand in 24 hrs.

$$\begin{aligned} &= 12 \times 2000 + \frac{12 \times 1000}{24} \\ &= 24000 + \frac{12000}{24} \\ &= \frac{36000}{24} \text{ kW} \\ &= 1500 \text{ kW} \end{aligned}$$

Maximum demand in 24 hrs is given as 2000 kW

$$\therefore \text{Load factor} = \frac{\text{Average Demand}}{\text{Maximum Demand}}$$

$$\begin{aligned} &= \frac{1500}{2000} \\ &= \frac{3}{4} = 0.75 \end{aligned}$$

Sol-3: (c)

The given is a L-L fault

$$\text{Here } I_f = \sqrt{3} I_{R1} = \sqrt{3} I_{R2}$$

$$\text{and } I_{R1} = -I_{R2}$$

Plug setting of the negative sequence relay is 0.2A.

Pick up current = Plug setting \times CT ratio

$$= 0.2 \times \frac{5}{1} = 1 \text{ Amp.}$$

1 Amp. is the negative sequence current.

$$\begin{aligned} \text{So, } I_f &= \sqrt{3} I_{f2} \\ &= \sqrt{3} \times 1 \\ &= 1.732 \text{ Amp.} \end{aligned}$$

Sol-4: (b)

\therefore Base impedance on L.V. side

$$\begin{aligned} &= \frac{(\text{kV})^2}{(\text{MVA})_B} = \frac{33^2}{20} \\ &= 54.45 \Omega \end{aligned}$$





IES MASTER

Institute for Engineers (IES/GATE/PSUs)

**ADMISSIONS
OPEN**

For CE, ME, EE, ECE

SESSION 2018-2019
ESE/GATE/PSUs

Batches
start on



IES Master Delhi Centre

27th Jan

Weekend Batch

(CE/ME/EE/ECE)

17th Feb

12th Feb

Regular Batch

(CE/ME/EE/ECE)

26th Feb

IES Master Noida Centre

27th Jan

Weekend Batch

(CE/ME/EE/ECE)

17th Feb

$$\begin{aligned} \therefore \text{Leakage reactance in } \Omega \text{ (on LV side)} \\ &= 54.45 \times 0.12 \\ &= 6.534 \Omega \end{aligned}$$

\Rightarrow So reactance per phase = 6.35Ω

In Δ connection, if the impedance in each arm is Z_1 , then per phase impedance (i.e. between phase and neutral) can be determined by converting equivalent star (Y).

$$\begin{aligned} Z_{ph} &= \frac{Z_1}{3} \therefore Z_1 = 3 \cdot Z_{ph} \\ &= 3 \times 6.534 \\ &= 19.6 \Omega \end{aligned}$$

Sol-5: (d)

X_d (in pu) on new base

$$\begin{aligned} &= X_{d,old} \frac{(MVA)_{new} \times (kV_{old})^2}{(MVA)_{old} \times (kV_{new})^2} \\ &= 0.4 \times \frac{100}{75} \times \left(\frac{10}{11}\right)^2 = 0.44 \text{ p.u.} \end{aligned}$$

Sol-6: (d)

\therefore Rated speed of hydraulic turbine = 250 rpm

\therefore Output frequency of generator = 50 Hz


If no of pole = P , then

$$N = \frac{120f}{P}$$

$$\text{or } P = \frac{120f}{N} = \frac{120 \times 50}{250} = 24$$

\therefore No. of pole required = 24

Sol-7: (b)

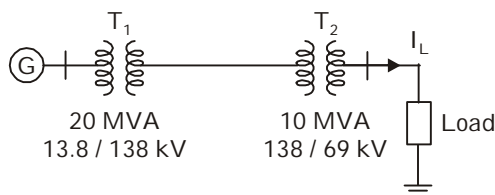

Base current on load side

$$(kA)_B = \frac{(MVA)_B}{\sqrt{3}(kV)_B}$$

\Rightarrow ($I_L = 0.72$ is given on 69 kV)

(kA)_B on Generator side,

$$\Rightarrow (kA)_{B_{new}} = \frac{(MVA)_B}{\sqrt{3} \cdot (kV)_{new}} = \frac{(MVA)_B}{\sqrt{3} \times 13.8}$$

Actual load current, $I_L = I_{L,pu} \times (kA)_{B_{old}}$
pu current on generator side;

$$\begin{aligned} \Rightarrow I_{p.u.,new} &= I_{p.u.,old} \times \frac{(kA)_{B_{old}}}{(kA)_{B_{new}}} \\ &= 0.72 \times \frac{13.8}{69} \\ &= 0.144 \end{aligned}$$

Sol-8: (b)

Given, $kV_{base} = 25kV$, $MVA_{base} = 200 \text{ MVA}$

Per unit reactance of

$$\begin{aligned} G_1 &= j0.09 \times \left(\frac{200}{100}\right) \times \left(\frac{25}{25}\right)^2 \\ &= j0.18 \end{aligned}$$

Per unit reactance of

$$\begin{aligned} G_2 &= j0.09 \times \left(\frac{200}{100}\right) \times \left(\frac{25}{25}\right)^2 \\ &= j0.18 \end{aligned}$$

Per unit reactance of

$$\begin{aligned} T_1 &= j0.12 \times \left(\frac{200}{90}\right) \times \left(\frac{25}{25}\right)^2 \\ &= j0.27 \end{aligned}$$


Per unit reactance of line = $\frac{X_{actual}}{X_{base}}$

$$\begin{aligned} &= \frac{150}{(220)^2} \times 200 \\ &= j0.62 \end{aligned}$$

Per unit reactance of

$$\begin{aligned} T_2 &= j0.12 \times \left(\frac{200}{90}\right) \times \left(\frac{220}{220}\right)^2 \\ &= j0.27 \end{aligned}$$

The impedance diagram of the power system is

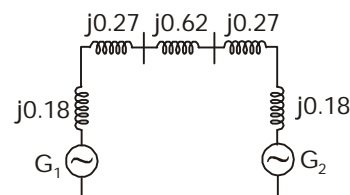

GATE

2018



27
YEARS
SOLUTION